


REQUESTING SERVICE FOR TEMPORARY CONSTRUCTION METERS

- ▶ Address must be acquired for each location prior to meter request.
- ▶ Request a temporary meter installation online through the [Developer & Builder Resources](#) page. Submit proof of passed inspection with the request, if required.
- ▶ Electrician to set approved temporary meter structure in proper location prior to request.
 - Proper location is immediately adjacent to transformer or pedestal providing power.
 - Temporary meter structure must be marked with address.
 - City inspection is required if within city limits.
- ▶ Once GVEC is notified of city inspection (where applicable), GVEC personnel will set temporary meter within 7-10 days.
- ▶ If temporary meter is deemed "out of spec" by GVEC lineman, a \$50 trip charge will be applied to account and meter must begin inspection process again.



Scan to visit the Developer & Builder Resources Page at gvec.org



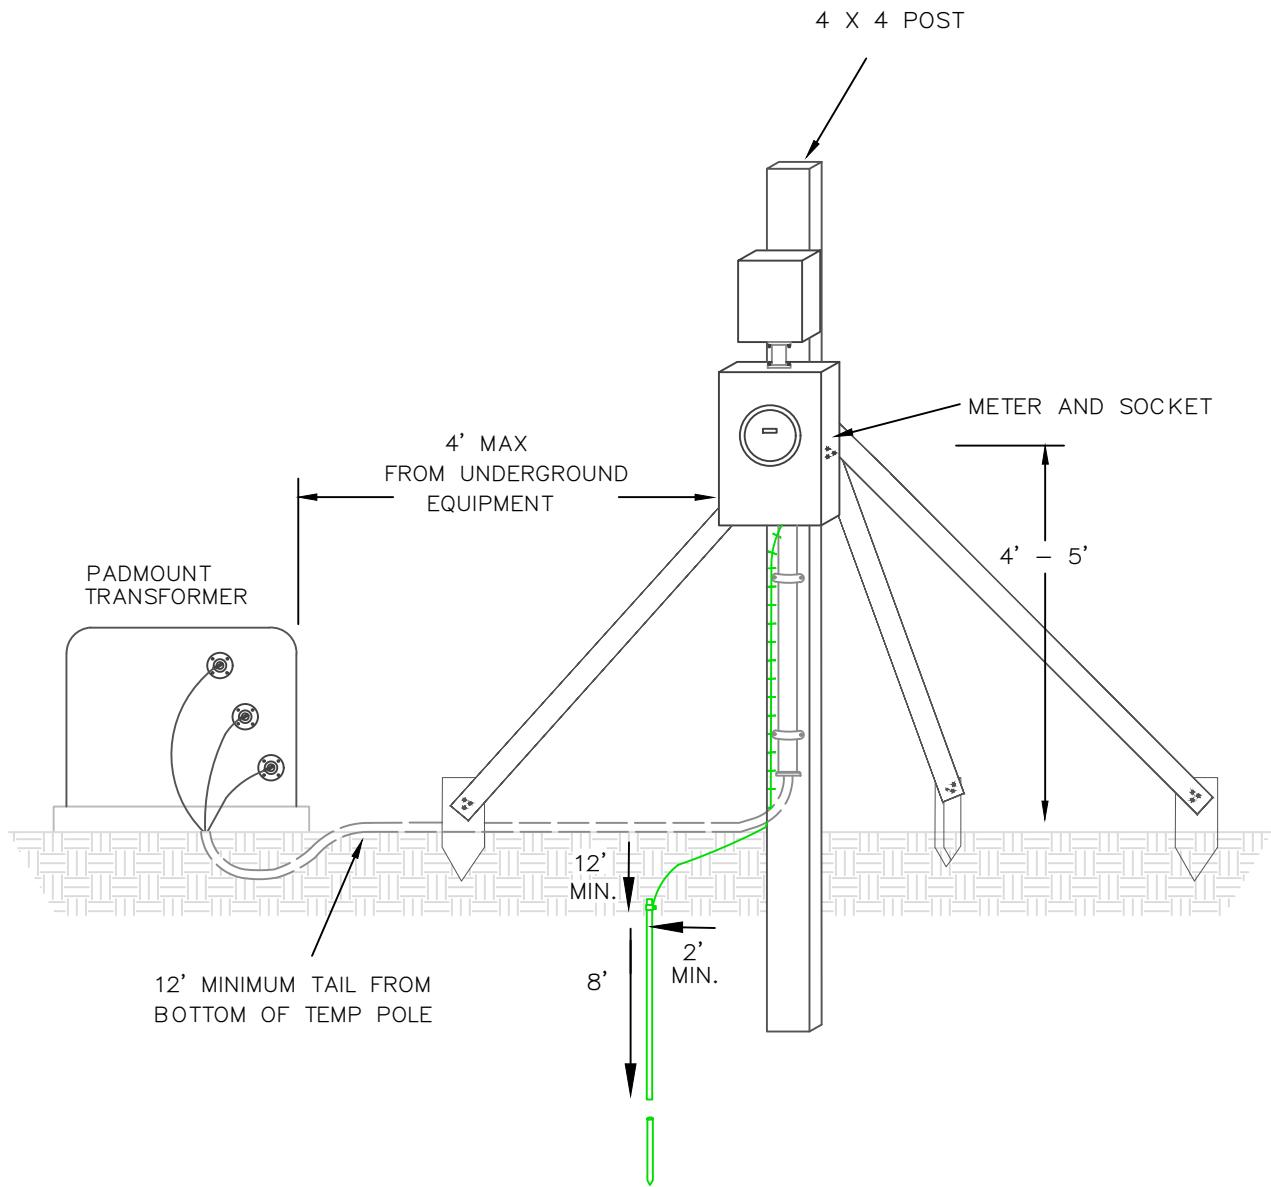

BUILD IN ACCORDANCE WITH
LOCAL BUILDING CODES

GUADALUPE VALLEY ELECTRIC COOPERATIVE


TEMPORARY SERVICE FROM
UNDERGROUND DISTRIBUTION

gvec
Delivering more.™

INTERNET | ELECTRIC | HOME

TEMP URD

DATE	REVISED BY	DATE	REVISED BY
3-24-2017	GB	6-21-2017	GB
4-11-2017	GB	9-19-2022	SAL

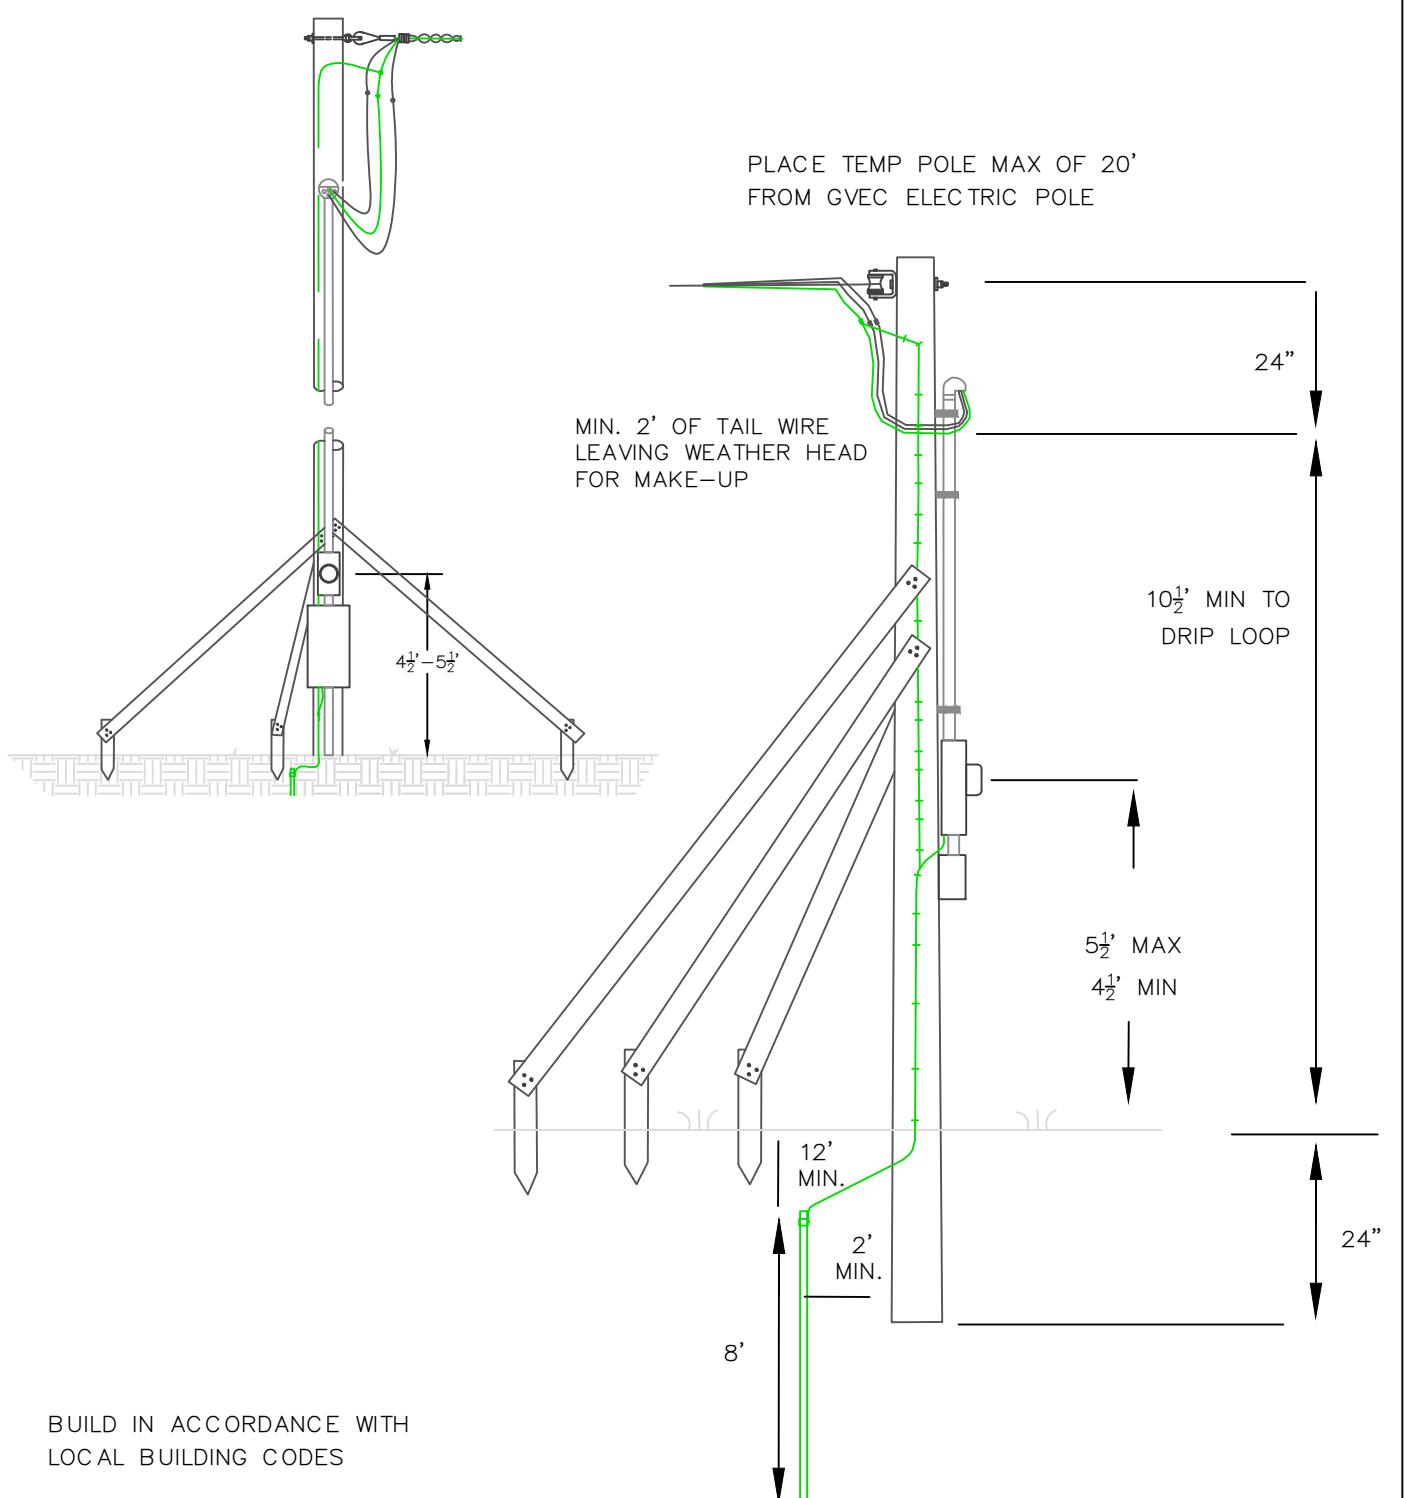

RISER MATERIAL CONDUIT
MUST BE RIDGED ALUMINUM
OR STEEL.

GUADALUPE VALLEY ELECTRIC COOPERATIVE

TEMPORARY SERVICE FROM
OVERHEAD DISTRIBUTION

gvec
Delivering more.™

INTERNET | ELECTRIC | HOME

TEMP SVC

DATE	REVISED BY	DATE	REVISED BY
2-17-2017	GB	3-27-2023	SAL
6-20-2017	GB		